

# Product Environmental Profile

## Harmony XVB Tower Light






## General information

Reference product	Harmony XVB Tower Light - XVCB21, XVCB2B4, XVCB2B3, XVCB5B8, XVBZ02
Description of the product	The representative product used for the analysis is illuminated LED indicator bank consisting of various units in the range (XVCB21, XVCB2B4, XVCB2B3, XVCB5B8 and XVBZ02). The product is an audible signaling units designed for indication of operating status in industrial applications.
Description of the range	Single product
Functional unit	The major function of the Harmony XVB range of products is to offer optical or audio signalling, specifically to identify the various states or sequences of a machine or installation from a distance and through 360° in life span of 10 years. This product will be active for 73% of the time, with a power consumption of 0.72W and adhering to standards IEC 60947-5-1.
Specifications are:	<p>IP Degree Of Protection -</p> <p>IP65 on fixing base XVBZ0. conforming to IEC 60529</p> <p>IP66 on base unit conforming to IEC 60529</p> <p>Pollution Degree - 2</p> <p>Ambient Air Temperature For Storage - -40...70 °C</p> <p>Electrical Shock Protection Class -</p> <p>Class I on support tube conforming to IEC 61140</p> <p>Class II on base unit conforming to IEC 61140</p>



## Constituent materials

Reference product mass	710.97 g including the product, its packaging and additional elements and accessories
------------------------	---

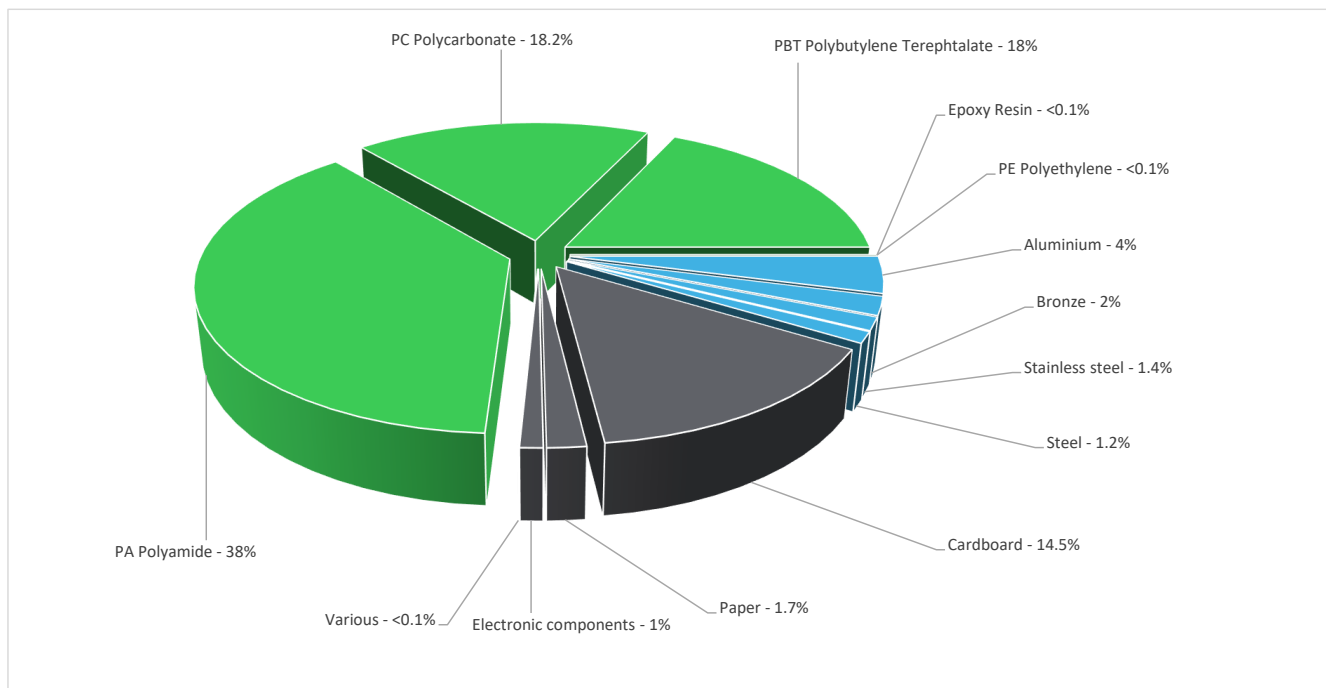

Plastics	74.2%
Others	17.2%
Metals	8.6%



## Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website

<https://www.se.com/ww/en/work/support/green-premium/>



## Additional environmental information

End Of Life	Recyclability potential:	9%	The recyclability rate was calculated from the recycling rates of each material making up the product with the exception of data using the ESR database. For materials or components using the ESR database or the absence of data the conservative hypothesis "0% recyclability" was used.
-------------	--------------------------	----	---



## Environmental impacts

Reference service life time	10 years			
Product category	Other equipments - Active product			
Installation elements	The product does not require special installation procedure and requires little to no energy to install.			
Use scenario	The product is in active mode 73% of the time with a power use of 0.72W, and in standby 27% of the time with a power use of 0W for 10 years			
Time representativeness	The collected data are representative of the year 2024			
Technological representativeness	The Modules of Technologies such as material production, manufacturing processes and transport technology used in the PEP analysis (LCA EIME in the case) are Similar and representative of the actual type of technologies used to make the product.			
Geographical representativeness	Rest of the World			
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]
	Electricity Mix; High voltage; 2018; Indonesia, ID	Electricity Mix; Low voltage; 2018; Asia Pacific, APAC	Electricity Mix; Low voltage; 2018; Asia Pacific, APAC	Electricity Mix; Low voltage; 2018; Asia Pacific, APAC
		Electricity Mix; Low voltage; 2018; Europe, EU-27	Electricity Mix; Low voltage; 2018; Europe, EU-27	Electricity Mix; Low voltage; 2018; Europe, EU-27
		Electricity Mix; Low voltage; 2018; United States, US	Electricity Mix; Low voltage; 2018; United States, US	Electricity Mix; Low voltage; 2018; United States, US
		Electricity Mix; Low voltage; 2018; Brazil, BR	Electricity Mix; Low voltage; 2018; Brazil, BR	Electricity Mix; Low voltage; 2018; Brazil, BR

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators		Harmony XVB Tower Light - XVC21, XVC2B4, XVC2B3, XVC5B8, XVBZ02						
Impact indicators	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to climate change	kg CO2 eq	3.20E+01	7.44E+00	1.72E+00	4.41E-03	2.14E+01	1.51E+00	-4.92E-01
Contribution to climate change-fossil	kg CO2 eq	3.19E+01	7.29E+00	1.72E+00	4.41E-03	2.13E+01	1.51E+00	-4.81E-01
Contribution to climate change-biogenic	kg CO2 eq	1.68E-01	1.45E-01	0*	0*	2.33E-02	0*	-1.08E-02
Contribution to climate change-land use and land use change	kg CO2 eq	2.00E-04	2.00E-04	0*	0*	0*	0*	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	2.24E-06	6.30E-07	1.51E-06	1.75E-10	9.50E-08	2.11E-09	-7.84E-08
Contribution to acidification	mol H+ eq	1.75E-01	3.94E-02	7.06E-03	5.94E-05	1.27E-01	1.38E-03	-3.07E-03
Contribution to eutrophication, freshwater	kg (PO4) <sup>3-</sup> eq	1.52E-04	1.09E-04	2.00E-07	2.19E-08	4.24E-05	3.62E-07	-1.65E-06
Contribution to eutrophication marine	kg N eq	2.54E-02	7.31E-03	3.21E-03	2.81E-05	1.43E-02	5.08E-04	-2.68E-04
Contribution to eutrophication, terrestrial	mol N eq	3.12E-01	7.05E-02	3.49E-02	2.86E-04	2.00E-01	5.85E-03	-2.98E-03
Contribution to photochemical ozone formation - human health	kg COVNM eq	8.31E-02	2.35E-02	1.16E-02	6.87E-05	4.64E-02	1.47E-03	-1.02E-03
Contribution to resource use, minerals and metals	kg Sb eq	2.39E-04	2.37E-04	1.47E-10	1.92E-10	1.21E-06	0*	-3.08E-05
Contribution to resource use, fossils	MJ	6.42E+02	1.27E+02	2.13E+01	5.06E-02	4.84E+02	8.86E+00	-7.15E+00
Contribution to water use	m3 eq	6.14E+00	5.11E+00	8.68E-02	1.05E-02	7.82E-01	1.52E-01	-1.23E-01

Inventory flows Indicators		Harmony XVB Tower Light - XVCB21, XVCB2B4, XVCB2B3, XVCB5B8, XVBZ02						
Inventory flows	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	9.56E+01	4.15E+00	1.39E-04	3.67E-05	9.15E+01	0*	-2.42E-01
Contribution to use of renewable primary energy resources used as raw material	MJ	5.33E-01	5.33E-01	0*	0*	0*	0*	0.00E+00
Contribution to total use of renewable primary energy resources	MJ	9.62E+01	4.68E+00	1.39E-04	3.67E-05	9.15E+01	0*	-2.42E-01
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	6.26E+02	1.11E+02	2.13E+01	5.06E-02	4.84E+02	8.86E+00	-7.15E+00
Contribution to use of non renewable primary energy resources used as raw material	MJ	1.65E+01	1.65E+01	0*	0*	0*	0*	0.00E+00
Contribution to total use of non-renewable primary energy resources	MJ	6.42E+02	1.27E+02	2.13E+01	5.06E-02	4.84E+02	8.86E+00	-7.15E+00
Contribution to use of secondary material	kg	1.02E-01	1.02E-01	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	1.45E-01	1.21E-01	2.02E-03	2.43E-04	1.82E-02	3.55E-03	-2.87E-03
Contribution to hazardous waste disposed	kg	6.81E+00	6.36E+00	1.42E-03	2.63E-05	4.38E-01	7.00E-03	-2.40E+00
Contribution to non hazardous waste disposed	kg	1.07E+01	6.80E+00	1.74E-03	1.14E-01	3.19E+00	5.75E-01	-6.72E-01
Contribution to radioactive waste disposed	kg	5.26E-03	4.34E-03	3.40E-04	9.26E-08	5.56E-04	2.16E-05	-5.08E-04
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	6.47E-02	8.44E-03	0*	0*	0*	5.62E-02	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	6.52E-04	9.59E-05	0*	0*	0*	5.56E-04	0.00E+00
* represents less than 0.01% of the total life cycle of the reference flow								
Contribution to biogenic carbon content of the product	kg of C	0.00E+00						
Contribution to biogenic carbon content of the associated packaging	kg of C	3.31E-02						

Mandatory Indicators		Harmony XVB Tower Light - XVCB21, XVCB2B4, XVCB2B3, XVCB5B8, XVBZ02							
Impact Indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	2.14E+01	0*	0*	0*	0*	0*	2.14E+01	0*
Contribution to climate change-fossil	kg CO2 eq	2.13E+01	0*	0*	0*	0*	0*	2.13E+01	0*
Contribution to climate change-biogenic	kg CO2 eq	2.33E-02	0*	0*	0*	0*	0*	2.33E-02	0*
Contribution to climate change-land use and land use change	kg CO2 eq	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to ozone depletion	kg CFC-11 eq	9.50E-08	0*	0*	0*	0*	0*	9.50E-08	0*
Contribution to acidification	mol H+ eq	1.27E-01	0*	0*	0*	0*	0*	1.27E-01	0*
Contribution to eutrophication, freshwater	kg (PO4)³⁻ eq	4.24E-05	0*	0*	0*	0*	0*	4.24E-05	0*
Contribution to eutrophication marine	kg N eq	1.43E-02	0*	0*	0*	0*	0*	1.43E-02	0*
Contribution to eutrophication, terrestrial	mol N eq	2.00E-01	0*	0*	0*	0*	0*	2.00E-01	0*
Contribution to photochemical ozone formation - human health	kg COVNM eq	4.64E-02	0*	0*	0*	0*	0*	4.64E-02	0*
Contribution to resource use, minerals and metals	kg Sb eq	1.21E-06	0*	0*	0*	0*	0*	1.21E-06	0*
Contribution to resource use, fossils	MJ	4.84E+02	0*	0*	0*	0*	0*	4.84E+02	0*
Contribution to water use	m3 eq	7.82E-01	0*	0*	0*	0*	0*	7.82E-01	0*

Inventory flows Indicators		Harmony XVB Tower Light - XVCB21, XVCB2B4, XVCB2B3, XVCB5B8, XVBZ02							
Inventory flows	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	9.15E+01	0*	0*	0*	0*	0*	9.15E+01	0*
Contribution to use of renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of renewable primary energy resources	MJ	9.15E+01	0*	0*	0*	0*	0*	9.15E+01	0*
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	4.84E+02	0*	0*	0*	0*	0*	4.84E+02	0*
Contribution to use of non renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of non-renewable primary energy resources	MJ	4.84E+02	0*	0*	0*	0*	0*	4.84E+02	0*
Contribution to use of secondary material	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of non renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to net use of freshwater	m³	1.82E-02	0*	0*	0*	0*	0*	1.82E-02	0*
Contribution to hazardous waste disposed	kg	4.38E-01	0*	0*	0*	0*	0*	4.38E-01	0*
Contribution to non hazardous waste disposed	kg	3.19E+00	0*	0*	0*	0*	0*	3.19E+00	0*
Contribution to radioactive waste disposed	kg	5.56E-04	0*	0*	0*	0*	0*	5.56E-04	0*
Contribution to components for reuse	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for recycling	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for energy recovery	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to exported energy	MJ	0*	0*	0*	0*	0*	0*	0*	0*

\* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v6.2-6, database version 2024-04 in compliance with ISO14044, EF 3.0 method is applied, for biogenic carbon storage, assessment methodology 0/0 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2312002_V1	Drafting rules	PCR-4-ed4-EN-2021 09 06
Date of issue	02-2025	Supplemented by	PSR-0005-ed3.1-EN-2023 12 08
		Information and reference documents	<a href="http://www.pep-ecopassport.org">www.pep-ecopassport.org</a>
		Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal <input checked="" type="checkbox"/> External <input type="checkbox"/>			
The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)			
PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022			
The components of the present PEP may not be compared with components from any other program.			
Document complies with ISO 14021:2016 "Environmental labels and declarations. Type II environmental declarations"			

Schneider Electric Industries SAS  
Country Customer Care Center  
<http://www.se.com/contact>  
35, rue Joseph Monier  
CS 30323  
F- 92500 Rueil Malmaison Cedex  
RCS Nanterre 954 503 439  
Capital social 928 298 512 €

[www.se.com](http://www.se.com)

ENVPEP2312002\_V1

Published by Schneider Electric  
©2024 - Schneider Electric – All rights reserved

02-2025